

**SUPPLEMENT No. 1 TO THE TEST REPORT
FIRES-FR-176-14-AUNE**

LGSF Floor joists – multi-storey buildings, system BORABELA

This is an electronic version of a test report which was made as a copy of test report officially issued in a paper form. The electronic version of a test report shall be used only for informative purposes. Any information listed in this test report is the property of the sponsor and shall not be used or published without written permission. Contents of this file may only be modified by the editor i.e. Testing laboratory FIRES s.r.o. Batizovce. Sponsor is allowed to publish this test report in parts only with written permission of the editor.



SUPPLEMENT No. 1 TO THE TEST REPORT

FIRES-FR-176-14-AUNE

Tested property: Fire resistance
Test method: EN 1365-2:1999
Type of test: Accredited / Notified (NB 1396)
Date of issue: 30. 09. 2014

Name of the product: LGSF Floor joists – multi-storey buildings, system BORABELA

Manufacturer: BORABELA s.r.o.,
Anenské nám. 948/3, Staré Město, 110 00 Praha 1, Czech Republic
FRAME FACTORY Sp. z.o.o.,
ul.Brzozowa 8A 97-400 Bełchatów, Poland

Sponsor: BORABELA s.r.o.,
Anenské nám. 948/3, Staré Město, 110 00 Praha 1, Czech Republic
FRAME FACTORY Sp. z.o.o.,
ul.Brzozowa 8A 97-400 Bełchatów, Poland

Test carried out: Fires, s.r.o., Testing laboratory
Task No.: PR-14-0371
Specimen received: 02. 09. 2014
Date of the test: 03. 09. 2014

Technician responsible for the technical side of this report: Michaela Gorlická

Number of pages: 3

Number of copies: 4

Copy No.: 3

Distribution list:

- Copy No. 1 FIRES, s. r. o., Osloboditeľov 282, 059 35 Batizovce, Slovak Republic (electronic version)
- Copy No. 2 BORABELA s.r.o., Anenské nám. 948/3, Staré Město, 110 00 Praha 1, Czech Republic (electronic version)
- Copy No. 3 FRAME FACTORY Sp. z.o.o., ul.Brzozowa 8A 97-400 Bełchatów, Poland (electronic version)
- Copy No. 4 BORABELA s.r.o., Anenské nám. 948/3, Staré Město, 110 00 Praha 1, Czech Republic
- Copy No. 5 FRAME FACTORY Sp. z.o.o., ul.Brzozowa 8A 97-400 Bełchatów, Poland

This report includes accreditation mark SNAS with additional mark ILAC-MRA. SNAS is signatory of ILAC-MRA, Mutual recognition agreement (of accreditation), which is focused on promoting of international acceptance of accredited laboratory data and reducing technical barriers to trade, such as the retesting of products on markets of signatories. More information about ILAC-MRA is on www.ilac.org. Signatories of ILAC-MRA are e.g. SNAS (Slovakia), CAI (Czech Republic), PCA (Poland), DakKS (Germany) or BMWA (Austria). Up to date list of ILAC-MRA signatories is on www.ilac.org/documents/mra_signatories.pdf. FIRES, s.r.o. Batizovce is full member of EGOLF also, more information www.egolf.org.uk.




1. DESCRIPTION OF THE CHANGE

This supplement to the test report changes text in clause No. **4.1 DESCRIPTION OF THE SPECIMEN FIXATION AND TYPE OF LOADING** as follows:

original text:

30 minutes before the fire test and during the fire test, the static load causing bending moment M_{0max} 14,63 kNm was applied on specimen surface by two forces $P = 38,6$ kN acc. to following scheme (this represent loading 450 kN/m²)

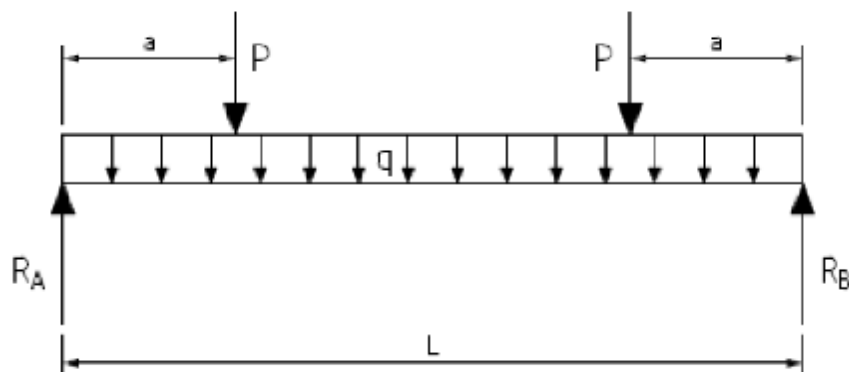


is changed for:

Applied loading:

30 minutes before the fire test and during the fire test, the static load causing bending moment M_{0max} 14,63 kNm was applied on specimen surface by two forces $P = 38,6$ kN acc. to following scheme (this represent loading 3,25 kN/m²):

$a = 1$ m

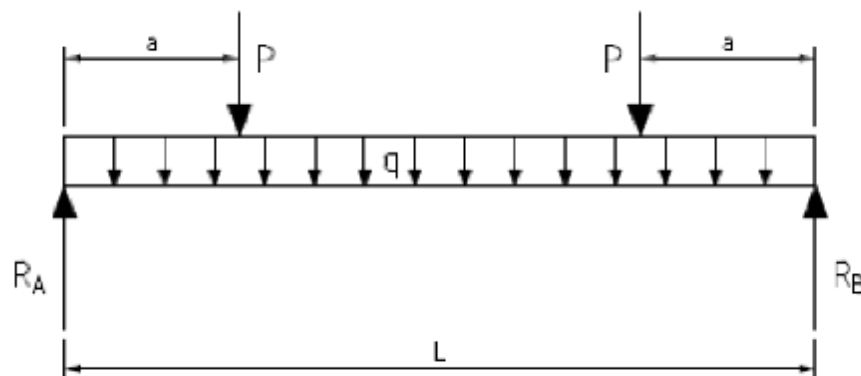



2. FINAL PROVISION

- § This supplement is non-detachable part of the test report. Sponsor has to attach this supplement always when using the test report.
- § Any modifications of the supplement to the test report can be made only by the FIRES, s.r.o., Batizovce.

Approved by:

Prepared by:

Ing. Štefan Rástocký
leader of the testing laboratory



Michaela Gorlická
technician of the testing laboratory

THE END OF SUPPLEMENT TO THE TEST REPORT

